

9.0 Direct Use of Recycled Water in-lieu of Groundwater Pumping

Introduction

Background

This alternative consists of developing a program involving delivery of recycled water from Southland WWTF to direct use as irrigation in-lieu of groundwater pumping from the principal production aquifer on Nipomo Mesa. This alternative provides for the disposition of effluent from Southland WWTP to locations other than the existing percolation ponds. Additionally, this alternative allows for an increase in operational flexibility of groundwater pumping by reducing the daily pumpage requirements.


Objective

As proposed, this scenario will provide for the transfer of a non-potable water source (reclaimed water from Southland WWTF) to users for direct reuse in irrigation of crops or turfgrass. The net available groundwater made available by this exchange would either be: (1) directly pumped (at the subject wells) and transmitted for use by NCSD; or (2) indirectly extracted by NCSD at existing or new well locations. Therefore, this scenario will effectively function as a groundwater management program and not a true supplemental water alternative.

The objectives of this alternative include:

- Stabilize and elevate existing groundwater pumping depressions; and
- Prolong useful life of existing NCSD wells.

DWG: W:\Nipomo_CSD (19996)\19996.32 (Alternative Water Supply)\CAD\Design\Revised Figures and Plates\Figure 9-1_Groundwater Exchange for Direct Reuse.dwg
 DATE: Jun 11, 2007 8:56am
 USER: cromero
 PROJECT: NIPOMO CSD (19996)

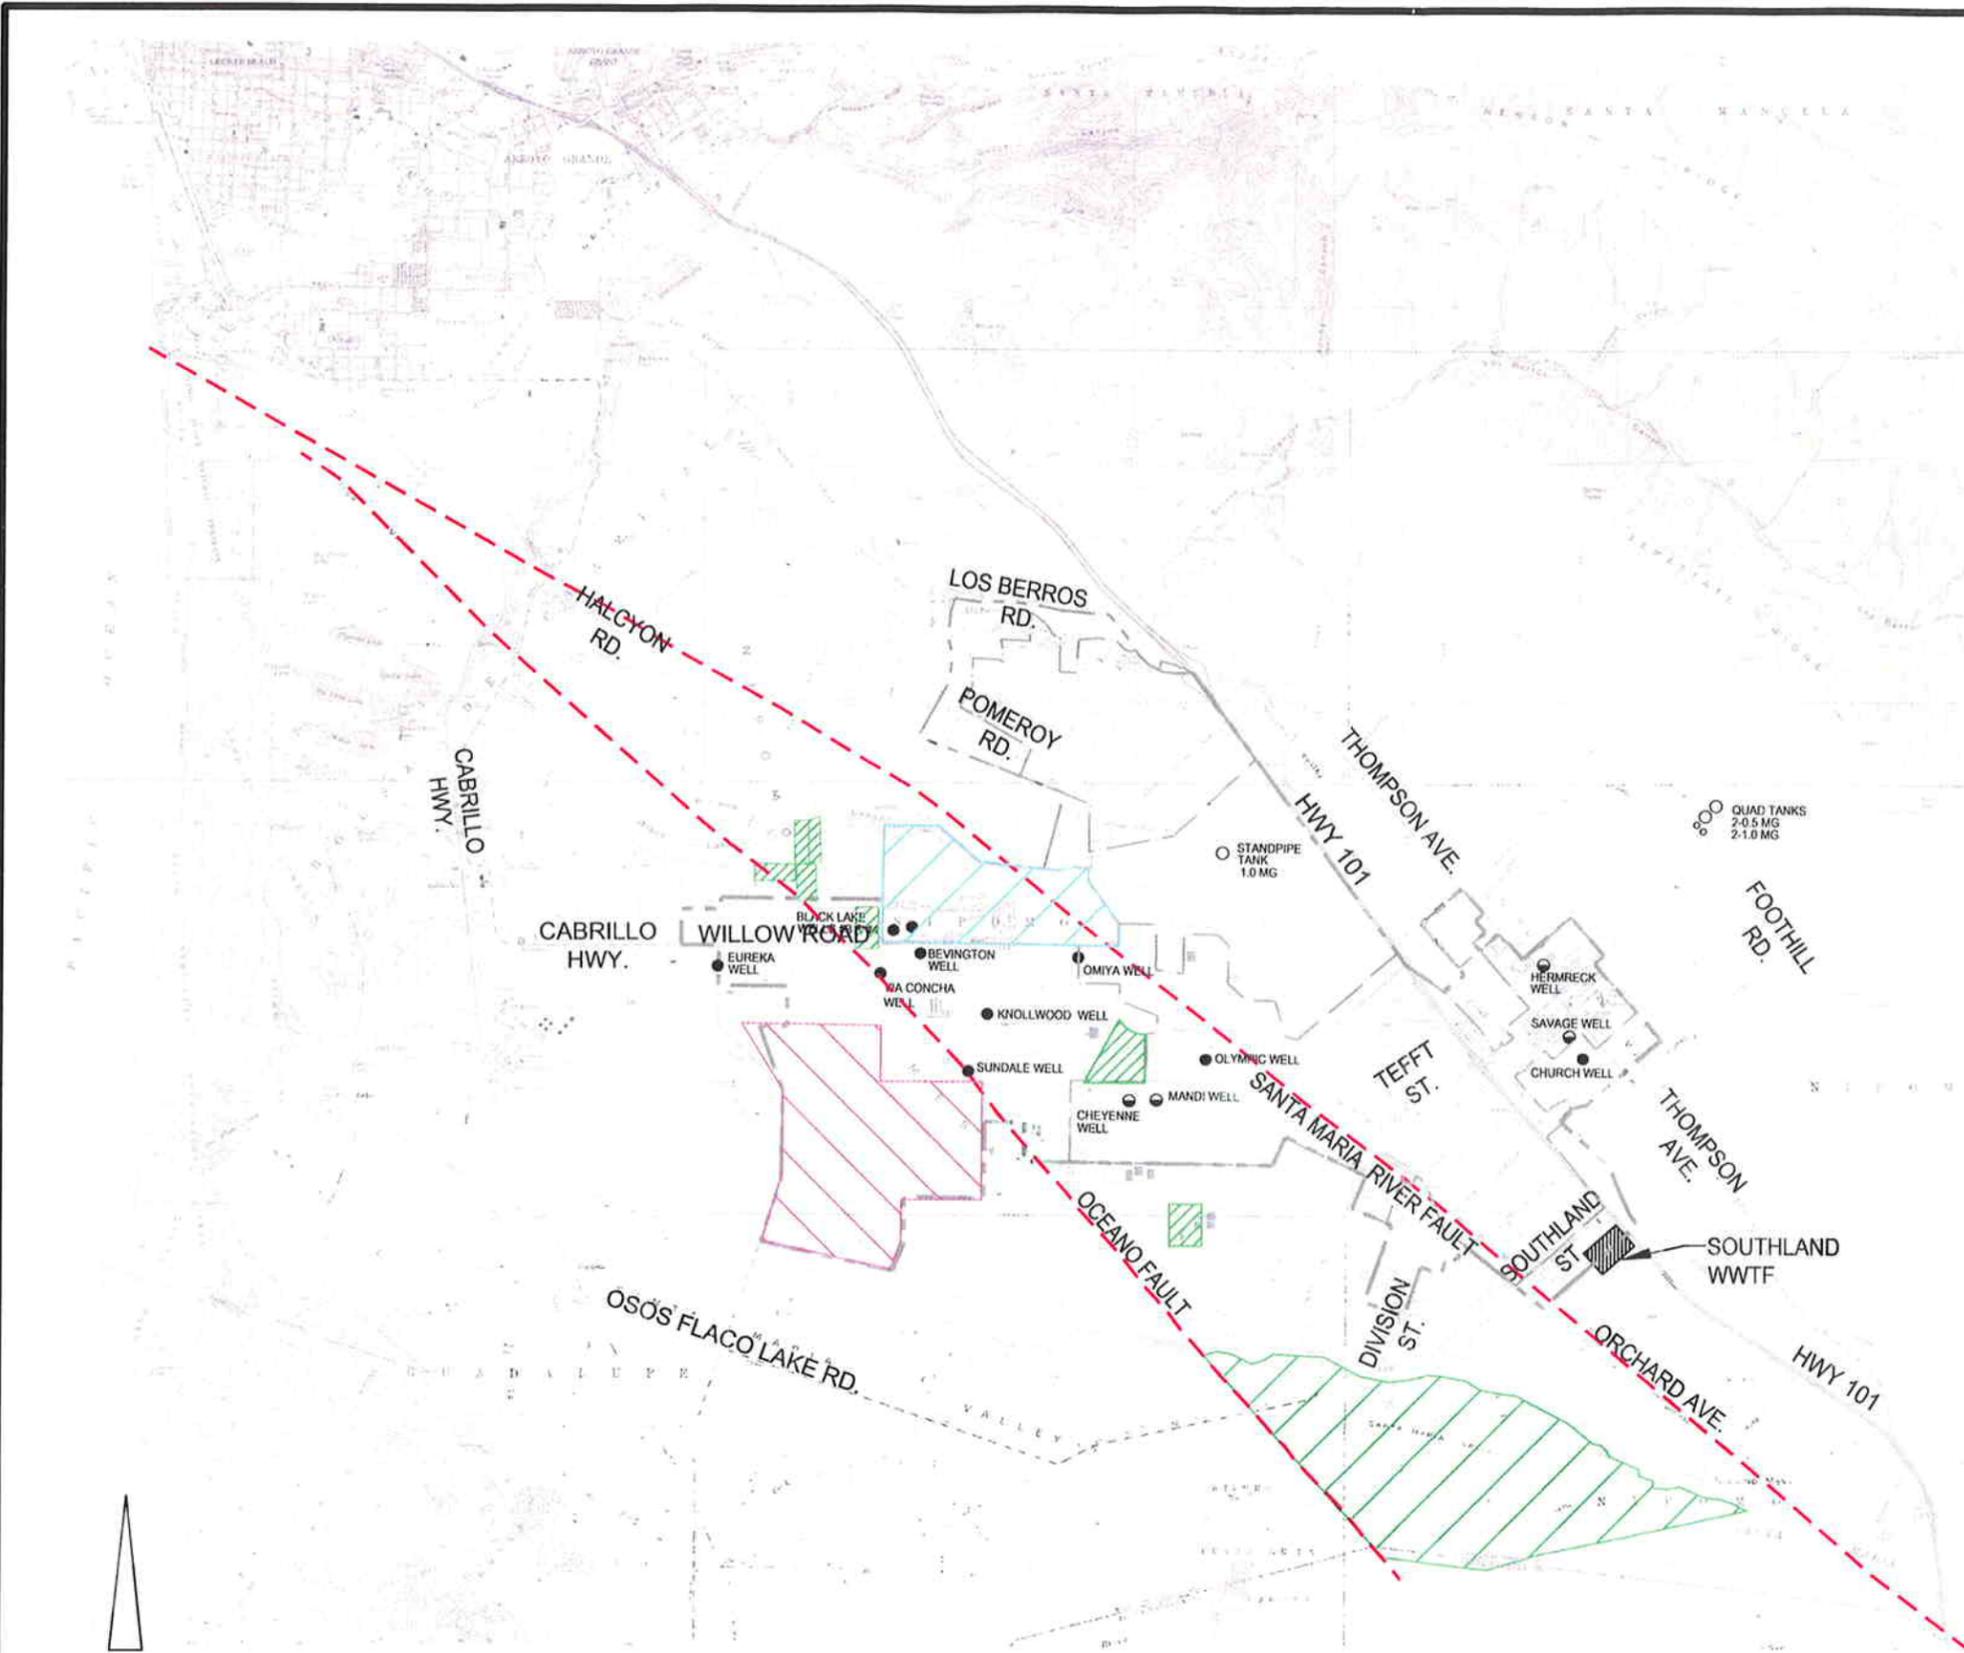


NOTES:

1. AGRICULTURAL LAND USE IS BASED ON THE SOUTH COUNTY-INLAND PLANNING AREA RURAL LAND USE CATEGORY AND COMBINING DESIGNATION MAP.

LEGEND

- NIPOMO CSD WELLS
- ◐ NIPOMO CSD WELLS (STANDBY)
- NIPOMO CSD TANKS
- FUTURE WATER SYSTEM SERVICE AREA BOUNDARY
- EXISTING WATER SYSTEM SERVICE AREA BOUNDARY
- - - APPROXIMATE FAULT LINE
- ▨ AGRICULTURAL LAND USE AREA BETWEEN FAULTS
 - 1443 ACRES IN VALLEY
 - 181 ACRES ON MESA
- ▨ BLACKLAKE DEVELOPMENT
- ▨ WOODLANDS DEVELOPMENT

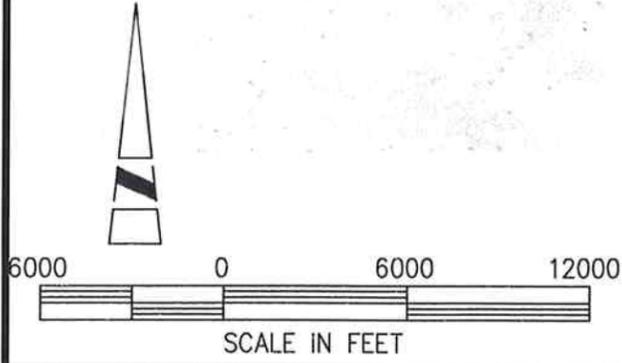

NIPOMO CSD EVALUATION OF SUPPLEMENTAL WATER ALTERNATIVES
DIRECT USE OF RECYCLED WATER IN-LIEU OF GROUNDWATER RECHARGE

BEC PROJECT NO.
 19996.32

FIGURE
9-1

Previous Studies/Documents

The following list summarizes the studies and documents referenced for this evaluation:

- Southland Wastewater Treatment Facility Master Plan (Boyle Engineering, Draft February 2007)
- Groundwater in Storage Underneath the Nipomo Mesa Management Area As of April 2006, Draft Technical Memorandum (SAIC, October 11, 2006)
- Nipomo Mesa Current and Projected Demands and Potential for Seawater Intrusion, Draft Technical Memorandum (SAIC, October 24, 2006)
- Urban Water Management Plan 2005 Update (SAIC, January 2006)
- Phase V Stipulation of the Santa Maria Groundwater Litigation (June 30, 2005)
- Nipomo Mesa Groundwater Resource Capacity Study (SS Papadopoulos, March 2004)
- Water Resources of the Arroyo Grande - Nipomo Mesa Area (DWR Southern District, 2002)
- Final Report: Evaluation of Water Supply Alternatives (Kennedy/Jenks, October 2001)
- Evaluation of Alternative Water Supplies (Bookman-Edmonston, July 1994)


Supply

Small Increase in "Supply":


The proposed groundwater exchange alternative is intended to function as a groundwater management program within the subject area of the NMMA. No, or very little, increase in supply to the District would result because the net effect of this type of exchange is much smaller than the volume of water exchanged. Figure 9-2 shows a water balance for a hypothetical exchange of 10 units of water. The assumptions used in this water balance include: (1) 20% of irrigation water returns to the aquifer, while the remainder is lost through evapotranspiration or shipped out of the NMMA as agricultural product, (2) approximately half the water demand of the District is used for irrigation with the remainder going to wastewater treatment, and (3) approximately 90% of water applied to the existing Southland WWTP reaches the aquifer, the remainder being lost to evaporation. As shown, the net impact of an exchange of 10 units of water is a net gain of one unit to the underlying aquifer. Small changes in the assumptions would alter this result slightly, but not significantly.

DWG: W:\Nipomo_CSD (19996)\19996.32 (Alternative Water Supply)\CAD\Design\Revised Figures and Plates\Figure 9-2_Net Effect of Direct Reuse.dwg
 DATE: Jun 11, 2007 9:13am XREFS: G-BD8x11h BEClogo IMAGES: USER: cromero

BEFORE

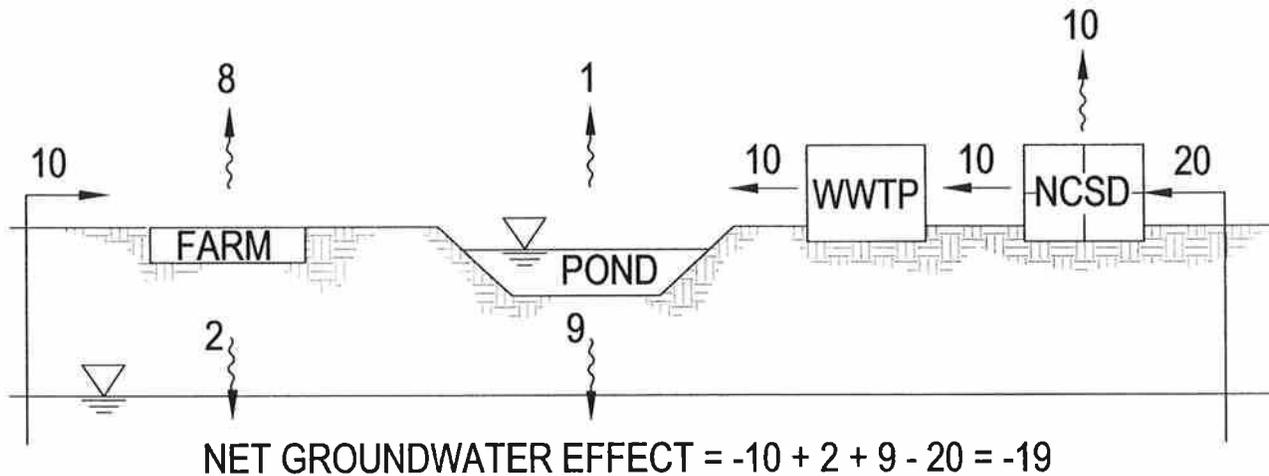

AFTER

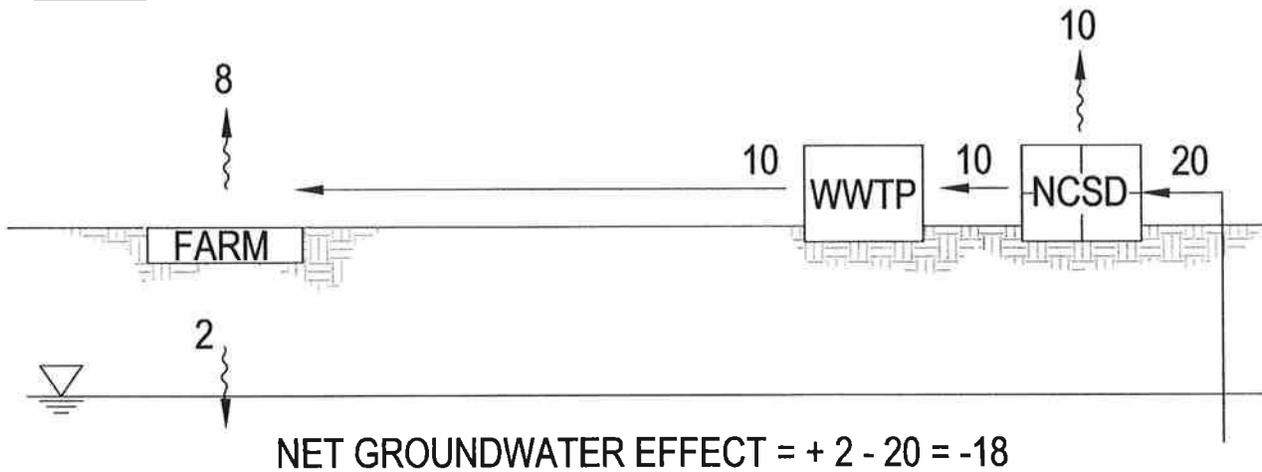

$$\text{TOTAL GROUNDWATER GAIN} = (\text{AFTER} - \text{BEFORE}) = -18 - (-19) = +1$$



NIPOMO COMMUNITY SERVICES DISTRICT
 NET EFFECT OF DIRECT USE OF RECYCLED WATER IN-LIEU OF GROUNDWATER PUMPING

BEC PROJECT NO.
 19996.32

FIGURE
9-2

As no new supplemental water will be imported from outside the NMMA, there will be no effect on the overall water balance within the NMMA. However, there may be some benefit to the specific study area, previously described as the depressed groundwater basin within the NMMA if agricultural pumping from this location is decreased.

Quantity Available from Southland WWTF:

Average annual flow rates to the Southland WWTP are currently 0.59 MGD, equivalent to approximately 662 acre-feet per year (AFY). These flows are projected to increase to 1,460 AFY (1.3 MGD) in the year 2030. For the purpose of this analysis, it is assumed effluent flows, and therefore flows discharged to the infiltration basins, are equivalent to the existing and projected influent flows.

Agricultural Demand for Applied Water:

Multiple attempts have been made in previous studies to estimate total demand for applied agricultural irrigation water for varying boundaries within the Nipomo Mesa. The estimated use in 1995 ranges between 1,600 AFY (2002 DWR) and 3,780 AFY (2003 SAIC), while projected use in 2020 ranges from 1,600 AFY (2002 DWR) to 4,410 AFY (2003 SAIC). The variation in these estimates can be explained by differences in the area studied and differences in method and assumptions used.

The range of agricultural demand values was used to develop a recycled water demand duty factor for estimating potential recycled water demand as follows:

- Average of historical and projected applied demands = $(1,600 + 4,410 \text{ AFY})/2 = 3,005 \text{ AFY}$
- Approximate Agricultural land use in Nipomo Mesa per 2002 DWR study, Table 4 = 1,220 Acres (as of 1995)
- Agricultural irrigation demand duty factor = $3,005 \text{ AFY}/1,220 \text{ Acres} \cong 2.5 \text{ feet/year}$

The potential recycled water demand within the studied area will likely be lower than the total agricultural demand for applied water. Assume 50% of the agricultural users switch to recycled water:

- Recycled water demand duty factor = $50\% \times 2.5 \text{ feet/year} = 1.25 \text{ ft/year}$.

This duty factor was then applied to the agricultural zoned parcels within the confines of the study area shown on Figure 9-1:

- Area on Figure 9-1 in agricultural operation = 181 acres
- Estimated recycled water demand within studied area = $1.25 \text{ ft/year} \times 181 \text{ acres} = 226 \text{ AFY}$.

Landscape Demand for Applied Water:

The Woodlands development plans to use a mixture of treated wastewater and well water to irrigate its golf course and landscaped areas. Total water demand for this mixed water for village landscaping,

business park, golf course, and evaporation from lined ponds is estimated at 824 AFY. The water demand for the development as a whole is estimated to be 1,583 AFY, while the wastewater plant is sized to treat 394 AFY (SLO County, 1998). Therefore, approximately 425 AFY of well water will be mixed with treated wastewater and used for irrigation, and may be available for exchange under this alternative.

The Blacklake development also includes a golf course and residential development, a dedicated wastewater treatment plant, and uses a mixture of treated wastewater and well water to irrigate its golf course and landscaped areas. With a total water demand of 450 AFY, assuming similar rates of wastewater generation and irrigation gives a rough estimate of 130 AFY of well water that is now mixed with treated wastewater for irrigation. This quantity may be available for exchange under this alternative.

Therefore it is estimated that 781 AFY (rounded to 800 AFY for this analysis) would be available for exchange under this alternative.

Quality

The proposed groundwater exchange may have negative impacts to water quality in the local, underlying aquifer due to salt accumulation. The following two criteria were considered in evaluating the quality of water resources proposed for exchange in this alternative:

- Quality of recycled water from Southland WWTF
- Quality of available groundwater for exchange within studied area

Recycled Water from Southland WWTF:

The Southland WWTF provides secondary treatment for wastewater generated within the Nipomo community. Constituents in treated wastewater from the Southland WWTF that may affect recycled water suitability for irrigation of crops or landscape species include salts or “total dissolved solids” (TDS, often estimated by the measurement of electrical conductivity, EC_w), sodium adsorption ratio (SAR), bicarbonates, chlorides, and boron. SAR is a measure of sodium hazard and is also used to predict reductions in soil permeability following application. Chlorides, boron, and sodium are ions that can reach toxic concentrations. Different crops vary in their tolerance to these constituents.

Constituents in Southland WWTF effluent with concentrations that may be problematic to crops include:

- Chloride
- Total Nitrogen (excess N may affect production of certain crops)
- TDS

- Sodium

Effluent quality data regarding boron, bicarbonates, EC_w, and SAR has not been collected. This data would be required to confirm suitability of reclaimed water for irrigation.

Title 22 of the California Code of Regulations (CCR) provides regulations for median and maximum total coliform limits in reclaimed water as well as usage restrictions. These regulations are driven by concerns for public safety and do not address suitability of reclaimed water for irrigation of crops. It is anticipated NCS D will attempt to meet the most stringent requirements in order to provide flexibility for all uses allowed under the Title 22 criteria.

Exchange Groundwater:

It is assumed the exchange groundwater will likely be pumped from existing NCS D wells. Therefore, water quality should be similar to existing groundwater pumped from within the NMMA.

If groundwater were pumped directly from an exchange participant's wells, and if no confining layer were present between the pumped aquifer and the place of application, water quality of the pumped groundwater could be impacted by the percolation of applied recycled water.

Reliability

Recycled Water from Southland WWTF:

Recycled water is considered a reliable water supply. However, its reliability as it pertains to exchange for direct use is contingent on the NCS D's ability to provide and maintain recycled water quality meeting the appropriate standards as well as taking additional necessary measures to mitigate salt accumulation in the groundwater basin.

Exchange Groundwater:

The groundwater will be extracted by existing or new NCS D wells, or by the exchange participant's wells. Therefore, the reliability of the return flows will be approximately the same as the existing groundwater supply. Therefore, its reliability may be hindered by drought conditions within the NMMA and any further development/expansion of the pumping depressions.

Required Facilities

In order to utilize its wastewater discharge as a resource, it is expected the NCS D will attempt to upgrade its treatment to provide Tertiary Recycled Water for Unrestricted Irrigation. As noted above, this level of treatment will require oxidation, coagulation, filtration and disinfection. The NCS D may

also need to consider blending the recycled water with higher quality groundwater in order to reduce TDS and other constituents of concern. In order to convey its recycled water to agricultural users, the NCSD would also need to construct storage, pumping, and transmission pipeline facilities.

Depending on the location(s) of potential agricultural users, the NCSD may also need to construct pumping and transmission facilities to convey pumped groundwater from the subject agricultural sites to interconnect with existing NCSD facilities. It is also possible NCSD may need to upgrade some of its existing water pumping, treatment, and transmission facilities. The extent of required upgrades is currently unknown.

Project Components:

For the purposes of comparison within the scope of this constraints analysis, the following facilities are assumed to be required to implement groundwater exchange of recycled water for agricultural production:

- Upgrades to Southland WWTF to provide Tertiary Recycled Water, including filtration and disinfection;
- Storage facilities at Southland WWTF, booster pump station(s), and transmission pipelines to convey recycled water to agricultural users; and
- Transmission facilities to convey pumped “exchange groundwater” from agricultural sites to NCSD facilities
- Upgrades to existing water pumping, treatment, and transmission facilities.

Implementation Schedule

It is estimated approximately 2 to 4 years will be required to fully implement this project.

Constraints

Institutional

Public perception with the use of recycled water for irrigation of food crops, non-food crops, and recreation areas may reduce the demand for recycled water.

Legal

NCSD will need to identify interested parties and enter into agreements with users.

Assuming 10% of this groundwater exchange is considered *New Developed Water* as defined in the Phase V Settlement Stipulation, NCSD may be required to obtain an order from the Court, quantifying

and allocating the rights to the New Developed Water, before they have the prior right to the New Developed Water.

Regulatory

In order to allow for unrestricted irrigation of crops, NCSD will need to upgrade its treatment to provide Tertiary Recycled Water. This level of treatment meets the most stringent of Title 22 criteria. NCSD will also need to revise the Waste Discharge Requirements for Southland WWTF to allow reuse of plant effluent for unrestricted urban use.

NCSD will need to satisfy the requirement of a Title 22 Engineering Report for DHS/RWQCB review.

The construction of an expanded treatment system, pipelines, percolation basins, and pumping facilities will require permits from local and state agencies.

Cost

The probable cost of improvements is approximately \$19 million and includes treatment and conveyance facilities. Amortizing this cost over 20 years and including approximately \$40,000 in annual operational costs brings the total annual cost to \$1.7 million. This alternative recycles 800 AFY of treated wastewater, but is expected to produce only 80 AFY of “new” return flows. Therefore, the cost per acre-foot of “new” water is \$21,000.

Capacity

Assuming that the Woodlands, Black Lake, and 50% of the agricultural users overlying the groundwater depression were to switch to irrigation with 100% recycled water, the total demand would be approximately 800 AFY. Average annual flow rates to the Southland WWTF are approximately 662 AFY, and are projected to increase to 1,460 AFY in the year 2030. Therefore, adequate supply does not now exist to make full use of this alternative, but is expected to become available within 20 years.

However, as noted above, it is reasonable to assume that for every 10 units of water exchanged, only one additional unit of groundwater would be made available. Therefore, at full capacity of 800 AFY exchange, perhaps as little as 80 AFY of additional water from the NMMA would be available.

10.0 Summary of Water Quality

The following table provides a summary of water quality for some of the alternatives considered. State and national drinking water standards (i.e., Primary and Secondary Maximum Contaminant Levels) are also provided.

**Nipomo Community Services District Evaluation of Supplemental Water Alternatives
Table 10-1 Summary of Water Quality Data & Drinking Water MCL's**

	CDHS MCL	USEPA MCL	Lake Nacimiento ¹			CCWA State Water (from PPWTP) ²						Nipomo Community Services District - Town Division ³						Santa Maria River Surface Water @ Bull Canyon Road ⁴			Cuyama Lane Water Company Well ⁵	City of Santa Maria Wells ⁶					
			See note 1			2005			2006			2005			2006			6/1/2000			Only one sample	2005			2006		
			Min	Max	Avg	Min	Max	Avg	Min	Max	Avg	Min	Max	Avg	Min	Max	Avg	Min	Max	Avg		Min	Max	Avg	Min	Max	Avg
Primary Standards																											
Aluminum (Al), ppm	1				0.05	0.26	0.11	0.049	0.220	0.128	--	0.4	0.067														
Antimony, ppm	0.006											2	--														
Arsenic (As), ppb	50	10										57	7.7	--	8	2.3	in sediment (mg/kg)	0.45									
Asbestos, MFL	7	7			4/1/1998	--																					
Barium (Ba), ppm	1	2										0.0223	0.062	0.0419													
Beryllium, ppm	0.004	0.004																									
Cadmium (Cd), ppm	0.005	0.005																									
Total Chlorine Residual, ppm					2	3.1	2.5	0.95	3.2	1.8																	
Chromium, ppm	0.05																										
Coliforms, Fecal MPN/100mL																											
Coliforms, Total, MPN/100mL	See Note 7		0	77,000	38,500																						
Copper, ppm		1.3																									
Cyanide, ppm	0.15																										
Fluoride, ppm	2	4					0.1		0.06				3	0.16													
Haloacetic acids (HAA), ppb	60	60			8.5	24.0	15.0	5.8	17.0	10.2																	
Lead, ppm	0.015	0.015																									
Mercury, ppb	2	2																									
MTBE, ppm	0.013																										
Nickel, ppm	0.1																										
Nitrate (as nitrogen), ppm	45				1.8	7.6	4.44			1.6			24.4	6.79	--	11.6	5.1	0.05	0.5	0.264							
Nitrate (as NO3), ppm	10						0.51			0.37								0.223	2.225	1.174	4/1/2001						
Nitrate+Nitrite (sum of nitrogen), ppm	1																	0.05	0.7	0.417							
Nitrite (as nitrogen), ppm	1																	0.015	0.05	0.037							
Perchlorate, ppb	See Note 8																										
Selenium (Se), ppm	0.05	0																									
Thallium, ppm	0.002	0.002																									
Total organic carbon, ppm			2.8	4.4	4	1.4	4.5	2.4	1.3	2.6	1.8																
Trichloroethylene (TCE), ppb	5	5																									
Total trihalomethanes (THM), ppb	80	80				37	72	53	25	47	36																
Secondary Standards																											
Aluminum (Al), ppm	0.2	0.05 - 0.2				0.05	0.26	0.11																			
Apparent Color (Unfiltered)	15	15																									
Chloride, ppm	250-500	250				21	125	65	21	125	52																
Copper, ppm	1																										
Corrosivity (Langlier Index)	--	--	-1.5	0.5	-0.5	--	--	--	--	--	--	-1	0.3	-0.2	-0.7	0.3	-0.2										
Iron (Fe), ppb	300	300	31	2,800	1,416																						
Manganese, ppm	0.05	0.05	0	0.640	0.320																						
MTBE, ppm	0.005																										
Odor Threshold	3	3				1	3	1	1	3	1																
Specific Conductance, umhos/cm	900					268	730	467	206	666	360	455	1410	903	554	1410	948	983	1610	1,211							
Sulfate (SO4), ppm	250-500	250						58			39	39	332	216	59	332	240	370	540	455	4/1/2001						
TDS, ppm	500	500				131	358	239	97	326	172	300	950	645	340	920	676	666	1210	898							
Turbidity, NTU	5		0.7	74	37	0.03	0.12	0.06	0.03	0.26	0.04																
Zinc, ppm	5	5																									
Radioactivity																											
Gross Alpha Particle Activity, pCi/L	15	15																									
Gross Beta Particle Activity, mrem/yr	4	4																									
Radium-226, pCi/L																											
Radium-228, pCi/L																											
Combined Radium-226 and Radium-228, pCi/L	5	5																									
Strontium-90, pCi/L	8																										
Tritium, pCi/L	20000																										
Uranium, pCi/L	20	30 ug/L																									
Additional Parameters																											
Alkalinity, mg/L as CaCO3			74	130	102	42	76	63	34	80	57																
Bicarbonate, ppm																											
Boron, ppm	See Note 9					8/15/02			0.098	ppb								0.120	0.230	0.164	4/1/2001						
Bromofom, ppb																											
Blue Green Algae, #/mm ²			0	232	116																						
Calcium (Ca), ppm			20	38	29	28	74	50	24	68	42							99	155	125	4/1/2001						
Chromium VI, ppb																											
DCPA Di-Mono Acid, ppb																											
Dibromochloromethane																											
Free CO2, ppm			1.2	63	32																						
Hardness as CaCO3, ppm						50	140	98	42	120	76	106	552	343	134	552	351	465	806	576	4/1/2001						
Heterotrophic Plate Count, CFU/mL						<1	2	1	<1	2	1																
Manganese, ppm	See Note 9		0	0.64	0.32																						
Magnesium (Mg), ppm																											
Odor, Tons			0	15	8																						
pH	6.5-8.5	6.54	8.86	8	6.7	9	8.1	6.9	8.9	8.2																	

11.0 Comparison of Alternatives

In this section each of the seven alternatives under consideration is compared to the Waterline Intertie Project. Separate comparisons are made concerning supply, water quality, reliability, and the time required to implement, as well as institutional, legal, and regulatory constraints.

Each alternative receives a score (1=best; 8=worst). These scores are then combined and a numerical ranking of alternatives is presented.

Supply

Ability to provide 3,000 AFY or 6,300 AFY

	Constraints	Supply	
	Alternative	Notes	Score
1	Santa Maria Valley Groundwater	Sufficient supply exists.	1
2	CCWA, State, or "Other" Water	Sufficient supply exists.	1
3	Desalination of Sea Water/Cooling Water	Sufficient supply exists.	1
4	Brackish Agricultural Drainage from Oso Flaco Watershed	440 to 968 AFY, assumed constrained by ag. return flows.	6
5	Nacimiento Water Project Extension	2,148 AFY	5
6	Recharge of Groundwater with Recycled Water from Southland WWTF	No Increase in Supply	8
7	Groundwater Exchange of Recycled Water for Direct Reuse	No or Very Little Increase in Supply	7
8	Waterline Intertie Project	Sufficient supply exists, with minor improvements to expand to 6,300 AFY	1

Water Quality

Constraints		Water Quality	
Alternative	Notes	Score	
1	Santa Maria Valley Groundwater	Insufficient data available. High TDS and nitrate may be a concern. Proximity to river makes treatment a likely requirement.	4
2	CCWA, State, or "Other" Water	Treated to Municipal Standards. Uses chloramines for disinfection, while District uses chlorine.	1
3	Desalination of Sea Water/Cooling Water	Depends on source. Seawater has history of successful treatment with RO. Cooling water may require additional treatment.	7
4	Brackish Agricultural Drainage from Oso Flaco Watershed	Poor water quality. Does not support "Municipal Water Supply" in Basin Plan.	8
5	Nacimiento Water Project Extension	Raw surface water from Lake Nacimiento	3
6	Recharge of Groundwater with Recycled Water from Southland WWTF	Salt, nitrogen, and other contaminants will require additional treatment upgrade at Southland WWTP	6
7	Groundwater Exchange of Recycled Water for Direct Reuse	Salt, nitrogen, and other contaminants will require additional treatment upgrade at Southland WWTP	5
8	Waterline Intertie Project	Santa Maria disinfects using chloramines. District would need to remove chloramines from new water, or convert existing system to chloramines.	1

Reliability

	Constraints	Reliability	
	Alternative	Notes	Score
1	Santa Maria Valley Groundwater	Reliability is good.	5
2	CCWA, State, or "Other" Water	Reliability depends on amount of allocation acquired. Long term average delivery = approx. 75% of allocation.	6
3	Desalination of Sea Water/Cooling Water	Reliability is good.	1
4	Brackish Agricultural Drainage from Oso Flaco Watershed	Unknown. More study required.	8
5	Nacimiento Water Project Extension	Reliability is considered good.	6
6	Recharge of Groundwater with Recycled Water from Southland WWTF	Reliability is similar to existing groundwater supply.	3
7	Groundwater Exchange of Recycled Water for Direct Reuse	Reliability is similar to existing groundwater supply.	3
8	Waterline Intertie Project	Reliability is considered good.	1

Implementation Schedule

	Alternative	Time Required	Score
1	Santa Maria Valley Groundwater	4 to 6 years	4
2	CCWA, State, or "Other" Water	4 to 6 years	4
3	Desalination of Sea Water/Cooling Water	6.5 to 10.5 years	7
4	Brackish Agricultural Drainage from Oso Flaco Watershed	7 to 10 years	8
5	Nacimiento Water Project Extension	5 to 7 years	6
6	Recharge of Groundwater with Recycled Water from Southland WWTF	2 to 4 years	2
7	Groundwater Exchange of Recycled Water for Direct Reuse	2 to 4 years	2
8	Waterline Intertie Project	2 to 3 years	1

Institutional Constraints

	Constraints	Institutional Constraints	
	Alternative	Notes	Score
1	Santa Maria Valley Groundwater	Need to purchase water rights from SMVMA user.	3
2	CCWA, State, or "Other" Water	Need approval from numerous institutions and voters. May be required to buy into past costs.	5
3	Desalination of Sea Water/Cooling Water	Will require cooperation with participants and/or affected landowners.	2
4	Brackish Agricultural Drainage from Oso Flaco Watershed	Lake is owned by State Parks, who would likely oppose extraction.	6
5	Nacimiento Water Project Extension	Need to act quickly if costs will be shared. FATAL FLAW (Project is out to bid.)	8
6	Recharge of Groundwater with Recycled Water from Southland WWTF	Public perception issues for use of recycled water and siting of percolation ponds.	7
7	Groundwater Exchange of Recycled Water for Direct Reuse	Public perception issues for use of recycled water may block implementation.	4
8	Waterline Intertie Project	MOU with City of Santa Maria is in place.	1

Legal Constraints

	Constraints	Legal Constraints	
	Alternative	Notes	Score
1	Santa Maria Valley Groundwater	Need to satisfy pending groundwater adjudication. Pumping at boundary may not be possible. FATAL FLAW.	8
2	CCWA, State, or "Other" Water	Will need to hold an election. Will need contracts to purchase water.	7
3	Desalination of Sea Water/Cooling Water	Will require contracts between cooperating participants (if any).	2
4	Brackish Agricultural Drainage from Oso Flaco Watershed	Part of the Santa Maria Valley Management Area, therefore requires approval of all litigants.	6
5	Nacimiento Water Project Extension	Need to execute appropriate contracts.	3
6	Recharge of Groundwater with Recycled Water from Southland WWTF	No "new supply" created.	4
7	Groundwater Exchange of Recycled Water for Direct Reuse	Would need court judgement to use any "new" water created.	5
8	Waterline Intertie Project	(None identified)	1

Regulatory Constraints

	Constraints	Regulatory Constraints	
	Alternative	Notes	Score
1	Santa Maria Valley Groundwater	Use of Twitchell reservoir water will require DWR license modification. DHS will require treatment.	6
2	CCWA, State, or "Other" Water	Treatment will require DHS approval. Minor resource agency oversight expected.	1
3	Desalination of Sea Water/Cooling Water	Coastal Commission, State Lands, and Resource Agencies' concerns will need to be addressed. Cooperating parties will require mutual agreements. DHS/RWCB permits will be required.	8
4	Brackish Agricultural Drainage from Oso Flaco Watershed	DHS would consider this an "Extremely impaired Source." Significant resource agency regulatory involvement expected.	7
5	Nacimiento Water Project Extension	CEQA via Supplemental EIR required. Resource agency permits required for construction. State and federal drinking water regulations would apply to treatment plant.	3
6	Recharge of Groundwater with Recycled Water from Southland WWTF	Requires new WDR for Southland WWTP, increased regulatory burden for recharging groundwater with recycled water, as well as nominal construction permitting.	5
7	Groundwater Exchange of Recycled Water for Direct Reuse	Requires new WDR for Southland WWTP, increased regulatory burden for using recycled water, as well as nominal construction permitting.	4
8	Waterline Intertie Project	State and federal drinking water regulations would apply to disinfection improvements. Resource agency permits required for construction.	1

Numerical Ranking of Alternatives

	Constraints	Summary		
	Alternative	Total Score	Rank	Biggest Obstacle
1	Santa Maria Valley Groundwater	29	4	FATAL FLAW Need to satisfy adjudication.
2	CCWA, State, or "Other" Water	24	2	Supply is limited and unreliable. Need significant political and institutional support.
3	Desalination of Sea Water/Cooling Water	28	3	Permitting from Coastal Commission and other Resource Agencies
4	Brackish Agricultural Drainage from Oso Flaco Watershed	49	8	Insufficient Supply and Poor Water Quality
5	Nacimiento Water Project Extension	29	4	FATAL FLAW Project is out to bid.
6	Recharge of Groundwater with Recycled Water from Southland WWTF	37	7	Not a new source.
7	Groundwater Exchange of Recycled Water for Direct Reuse	32	6	Insufficient supply.
8	Waterline Intertie Project	10	1	Capital Cost

12.0 Conclusions

Comparison of Alternatives

As discussed in previous sections, the following alternatives appear to have “fatal flaws” that would prevent the District from pursuing them as viable, supplemental water sources:

Santa Maria Valley Groundwater – This alternative would likely affect the flow of water between Santa Maria Valley and the NMMA, and would likely be prevented as a result of the adjudication.

Nacimiento Water Project Extension – The Nacimiento Water Project is currently out to bid, and as designed would not deliver the District’s desired 3000 AFY. Revisions to the project would cost at least \$4000 per AF for extending the pipeline from City of San Luis Obispo to Nipomo, not including costs to increase the pipeline upstream of San Luis Obispo to expand capacity and deliver 3000 AFY.

Oso Flaco Drainage - Although drainage from Oso Flaco could be treated, and this alternative does not have any “fatal flaws”, it is not considered to be a feasible supplemental water alternative due to the poor water quality of the water, inadequate quantity, likelihood of requiring approval from parties in Santa Maria Valley adjudication, and lack of support expected from CDHS.

Groundwater Recharge or Reuse - Groundwater recharge of treated wastewater, and direct reuse of this resource, will not increase the water supply available to the District, but may assist with managing groundwater depressions and with providing a market for treated plant effluent because onsite discharge may no longer be desired at Southland WWTF.

Seawater Desalination - Seawater desalination is expected to take many years for implementation, would be an expensive water supply, and would require many years of studies and negotiation with resource agencies, but would represent the most reliable water supply available to the District. While this may not meet the District’s short-term need for water, it is recommended that the District consider desalination in long-term water supply planning. Desalination will be addressed in more detail in Task 3 of this evaluation.

State Water or “Other” Water - Although direct purchase of 3,000 AFY or 6,300 AFY of State Water from the SWP pipeline does not appear to be feasible, due to institutional and legal constraints, acquiring off-peak or excess capacity and storing that water in an aquifer storage-recovery facility may be viable. This alternative will be explored in greater detail in Task 2 of this evaluation, and the evaluation will benefit from an ongoing analysis of the Natomas water exchange (currently being conducted by Hatch & Parent, as mentioned previously).

Summary of Relative Costs

Although detailed cost opinions were not developed in this evaluation, cost is considered one of the primary criteria for determining whether alternatives are feasible. The planning-level \$/AFY costs developed in previous sections, along with notes identifying any unsubstantiated but expected costs, are summarized below.

Table 12-1 Relative Costs per Acre-Foot

	Alternative	Facilities and O&M	Water Purchase	Other	Total
1	Santa Maria Valley Groundwater	\$520 to \$770	\$1,250 ⁽¹⁾	Site purchase at Hutton or Oso Flaco Road	\$1,770 to \$2,020 plus land cost
2	CCWA, State, or "Other" Water	\$130 to \$380	\$1,500 ⁽²⁾	\$436/af ⁽²⁾ refinance past capital costs	\$2,070 to \$2,310
3	Desalination of Sea Water/Cooling Water	\$2,200 to \$2,600	0	Site purchase or lease cost	\$2,200 to \$2,600 plus land cost
4	Brackish Agricultural Drainage from Oso Flaco Watershed	\$2,300 to \$2,700	0	Site purchase or lease cost	\$2,300 to \$2,700 plus land cost
5	Nacimiento Water Project Extension	\$1,100 ⁽³⁾	\$1,900 to \$2,100 ⁽⁴⁾	\$1,000 + for storage, pumping and treatment	\$4,000 or more
6	Recharge of Groundwater with Recycled Water from Southland WWTF	\$1,100 to \$2,320 per AF recycled (No new water supplied)		Site purchase for percolation basins	\$1,100 to \$2,320 plus land cost
7	Groundwater Exchange of Recycled Water for Direct Reuse	\$21,000 (80 AFY new water)			\$21,000
8	Waterline Intertie Project	\$470 to \$850	\$1,250		\$1,720 to \$2,100

(1) Assumed equal to MOU purchase price.
 (2) Carpinteria sale to PXP (CVWD, 2006).

(3) Transmission main only from SLO City turnout.
 (4) Assumed equal to estimated cost for delivery to SLO City turnout.

References

Reports/Documents

American States Water Company and Golden State Water Company, Securities and Exchange Commission Form 10-K for Annual and Transition Reports Pursuant to Sections 13 or 15(d) of The Securities Exchange Act of 1934, Fiscal Year Ending December 31, 2006

Beychok, Milton R. (1967). Aqueous Wastes from Petroleum and Petrochemical Plants, 1st Edition, John Wiley and Sons. LCCN 67-19834, referenced in http://en.wikipedia.org/wiki/Water_cooling.

Black & Veatch. Nacimiento Water Project: Technical Memorandum (TM) 8 Water Quality Investigations for San Luis Obispo County Flood Control & Water Conservation District (SLOCFCWCD), January 2006

Black & Veatch in Association with Boyle Engineering. Nacimiento Water Project: Preliminary Design Report (PDR) for SLOCFCWCD, July 2006.

Bookman-Edmonston Engineering, Inc. Evaluation of Alternative Supplemental Water Supplies, July 15, 1994. Prepared for Nipomo Community Services District

Boyle Engineering Corporation. Nipomo Waterline Intertie Project – Preliminary Engineering Memorandum (Draft), November 2006.

Boyle Engineering Corporation. Nacimiento Reservoir: Reliability As a Water Source for San Luis Obispo County, October 2002

Boyle Engineering Corporation. AIWRP Water Supply Evaluation: Nacimiento Treatment Evaluation for City of El Paso de Robles, September 2006

Boyle Engineering Corporation. Southland Wastewater Treatment Facility Master Plan, Draft February 2007

California Coastal Commission. Seawater Desalination and the California Coastal Act, March 2004.

California Department of Health Services. Groundwater Recharge Reuse DRAFT Regulation, January 4, 2007.

California Department of Water Resources. Notice to State Water Project Contractors, Article 21 Water Program for 2006, December 27, 2005.

California Department of Water Resources, Bay-Delta Office. The State Water Project Delivery Reliability Report 2005, April 2006.

California Department of Water Resources , California Water Plan Update, Bulletin 160-98 , Executive Summary, November 1998

California Department of Water Resources and SBCFC & WCD, Contract Between the State of California Department of Water Resources and SBCFC & WCD for a Water Supply (1963)

California Department of Water Resources and SLOCFC & WCD, Contract Between the State of California Department of Water Resources and SLOCFC & WCD for a Water Supply (1963)

California Regional Water Quality Control Board, Central Coast Region, 2002, Staff Report for Regular Meeting of April 19, 2002, Item 11, Reissuance Of National Pollutant Discharge Elimination System, Permit For Tosco Refining Company, Santa Maria Refinery, San Luis, Obispo County--Order No. R3-2002-0010, NPDES No. CA0000051.

Carpinteria Valley Water District. Minutes of the Regular Meeting of the Board of Directors, April 26, 2006.

Central Coast Ambient Monitoring Program (CCAMP). 312 Santa Maria River Hydrologic Unit Draft Report for Sampling Year 2000

Central Coast Water Authority. 2005 Urban Water Management Plan, October 2005.

Central Coast Water Authority. The State Water Project in Santa Barbara County, <http://www.ccwa.com/history/index.html>, 2007.

CH2MHill. 2005 Urban Water Management Plan – City of Santa Maria, Public Review Draft, February 2007.

Department of Water Resources, Southern District. Water Resources of the Arroyo Grande – Nipomo Mesa Area, 2002.

Garing Taylor & Associates. Task 25 – Results of Screening Evaluation, January 16, 2007.

Gibbs, Dennis, Hydrologist. 2005 Santa Barbara County Groundwater Report, March 28, 2006. Prepared for Santa Barbara County Public Works Water Resources Department

Kennedy/Jenks Consulting. Final Report, Evaluation of Water Supply Alternatives, October 2001. Prepared for Nipomo Community Services District

Massachusetts Institute of Technology, 2007, Environmental Virtual Campus, <http://www.c2e2.org/evc/PwrBlow.html>

Padre Associates, Inc. Supplemental Water Alternatives Environmental and Permitting Constraints Analysis, May 2007.

Penfield & Smith. Pipeline System Modeling, Tank 1 to Santa Ynez Pump Facility Definition of Available Extra Capacity, June 2006. Prepared for the Central Coast Water Authority

SAIC Engineering, Inc. Response to Boyle Engineering Questions 6-11 - Santa Maria River Underflow SAIC Project Number: 01-0236-00-9785, Draft Technical Memorandum dated June 5, 2007

SAIC Engineering, Inc. Groundwater in Storage Underneath the Nipomo Mesa Management Area as of April 2006, 01-0236-00-9100, technical memorandum dated October 11, 2006

SAIC Engineering, Inc. Nipomo Mesa Current and Projected Demands and Potential for Seawater Intrusion, Draft Technical Memorandum dated October 24, 2006

SAIC Engineering, Inc. Santa Maria River Estuary and Enhancement Management Plan, dated March, 2004. Prepared for The Dunes Center

SAIC Engineering, Inc. Urban Water Management Plan 2005 Update, Adopted January 25, 2006. Prepared for Nipomo Community Services District

SLOCFCWCD. Meeting Agendas from NWP Commission and Board of Supervisors of the SLOCFCWCD

S.S. Papadopulos & Associates, Inc. Nipomo Mesa Groundwater Resource Capacity Study, March 2004. Prepared for San Luis Obispo County

Superior Court of the State of California – County of Santa Clara, Phase V Stipulation of the Santa Maria Groundwater Litigation Case No.CV770214, June 30, 2005

URS Corporation. Final Urban Water Management Plan – Goleta Water District, December 20, 2005.

Wallace Group. Draft Supplemental Water Supply Study for Nacimiento Pipeline Extension and Desalination, January 2006. Prepared for the City of Arroyo Grande

Wallace Group. Water Supply Study: Desalination, Draft, for Oceano Community Services District, City of Arroyo Grande, and City of Grover Beach, January 2006.

Water Quality Data

City of Santa Maria

City of Santa Maria. 2005 Water Source for City of Santa Maria Water Wells and Central Coast Water Authority.

City of Santa Maria. Draft 2006 Water Source for City of Santa Maria Water Wells and Central Coast Water Authority.

Central Coast Water Authority (CCWA)

Central Coast Water Authority (CCWA). Polonio Pass Water Treatment Plant 2004 through 2006 Consumer Confidence Report Data.

Cuyama Lane Water Company

San Luis Obispo County Public Health Dept., Environmental Health Services Division, Data for 2006

Nacimiento Lake

Black and Veatch. Nacimiento Water Project Technical Memo 8 - Water Quality Investigation, January 13, 2006

Boyle Engineering Corporation. AIWRP Nacimiento Treatment Evaluation, September 2006.

Nipomo Community Services District

Nipomo Community Services District. 2005 Water Quality Consumer Confidence Report.

Nipomo Community Services District. 2006 Water Quality Laboratory Test Data for Wells.

Oso Flaco Water Bodies

Cachuma Resource Conservation District and the Dunes Center. Draft Nitrate and Sediment Assessment, Oso Flaco Watershed, San Luis Obispo County, California, August 2004. Report prepared for California Regional Water Quality Control Board, Central Coast Region

Central Coast Ambient Monitoring Program (CCAMP). Water Quality Data for Hydrologic Area: Oso Flaco Creek 312OFC @ Oso Flaco Lake Road, Oso Flaco Lake 312OFL @ culvert, and Little Oso Flaco Creek 312OFN. <http://www.ccamp.org/ca300/3/312/3121/3121wb.htm>

Central Coast Regional Water Quality Control Board, San Luis Obispo, California. Summary of Santa Maria and Oso Flaco Fecal Coliform TMDL Report, December 6, 2006. Prepared for CEQA Scoping Meeting and Public Workshop for Santa Maria and Oso Flaco

Central Coast Regional Water Quality Control Board, San Luis Obispo, California. Summary of Santa Maria and Oso Flaco Nitrate and Unionized Ammonia TMDL Report, December 6, 2006. Prepared for CEQA Scoping Meeting and Public Workshop for Santa Maria and Oso Flaco

Central Coast Regional Water Quality Control Board, San Luis Obispo, California. Phase Four: Project Analyses, Final Preliminary Project Report, Total Maximum Daily Loads for Nitrate and Ammonia in Santa Maria River and Oso Flaco Creek watersheds, Santa Barbara and San Luis Obispo Counties, California, December 5, 2006.

Santa Maria River Surface or Underflow

Central Coast Ambient Monitoring Program (CCAMP). Water Quality Data for Hydrologic Area: Santa Maria River 312SBC @ Bull Canyon Road. <http://www.ccamp.org/ca300/3/312/3121/3121wb.htm>

Personal Communication

Ogren, Paavo, Deputy Director of Public Works, San Luis Obispo County, email to Boyle Engineering, 6-10-07.